


ADRESSBUS

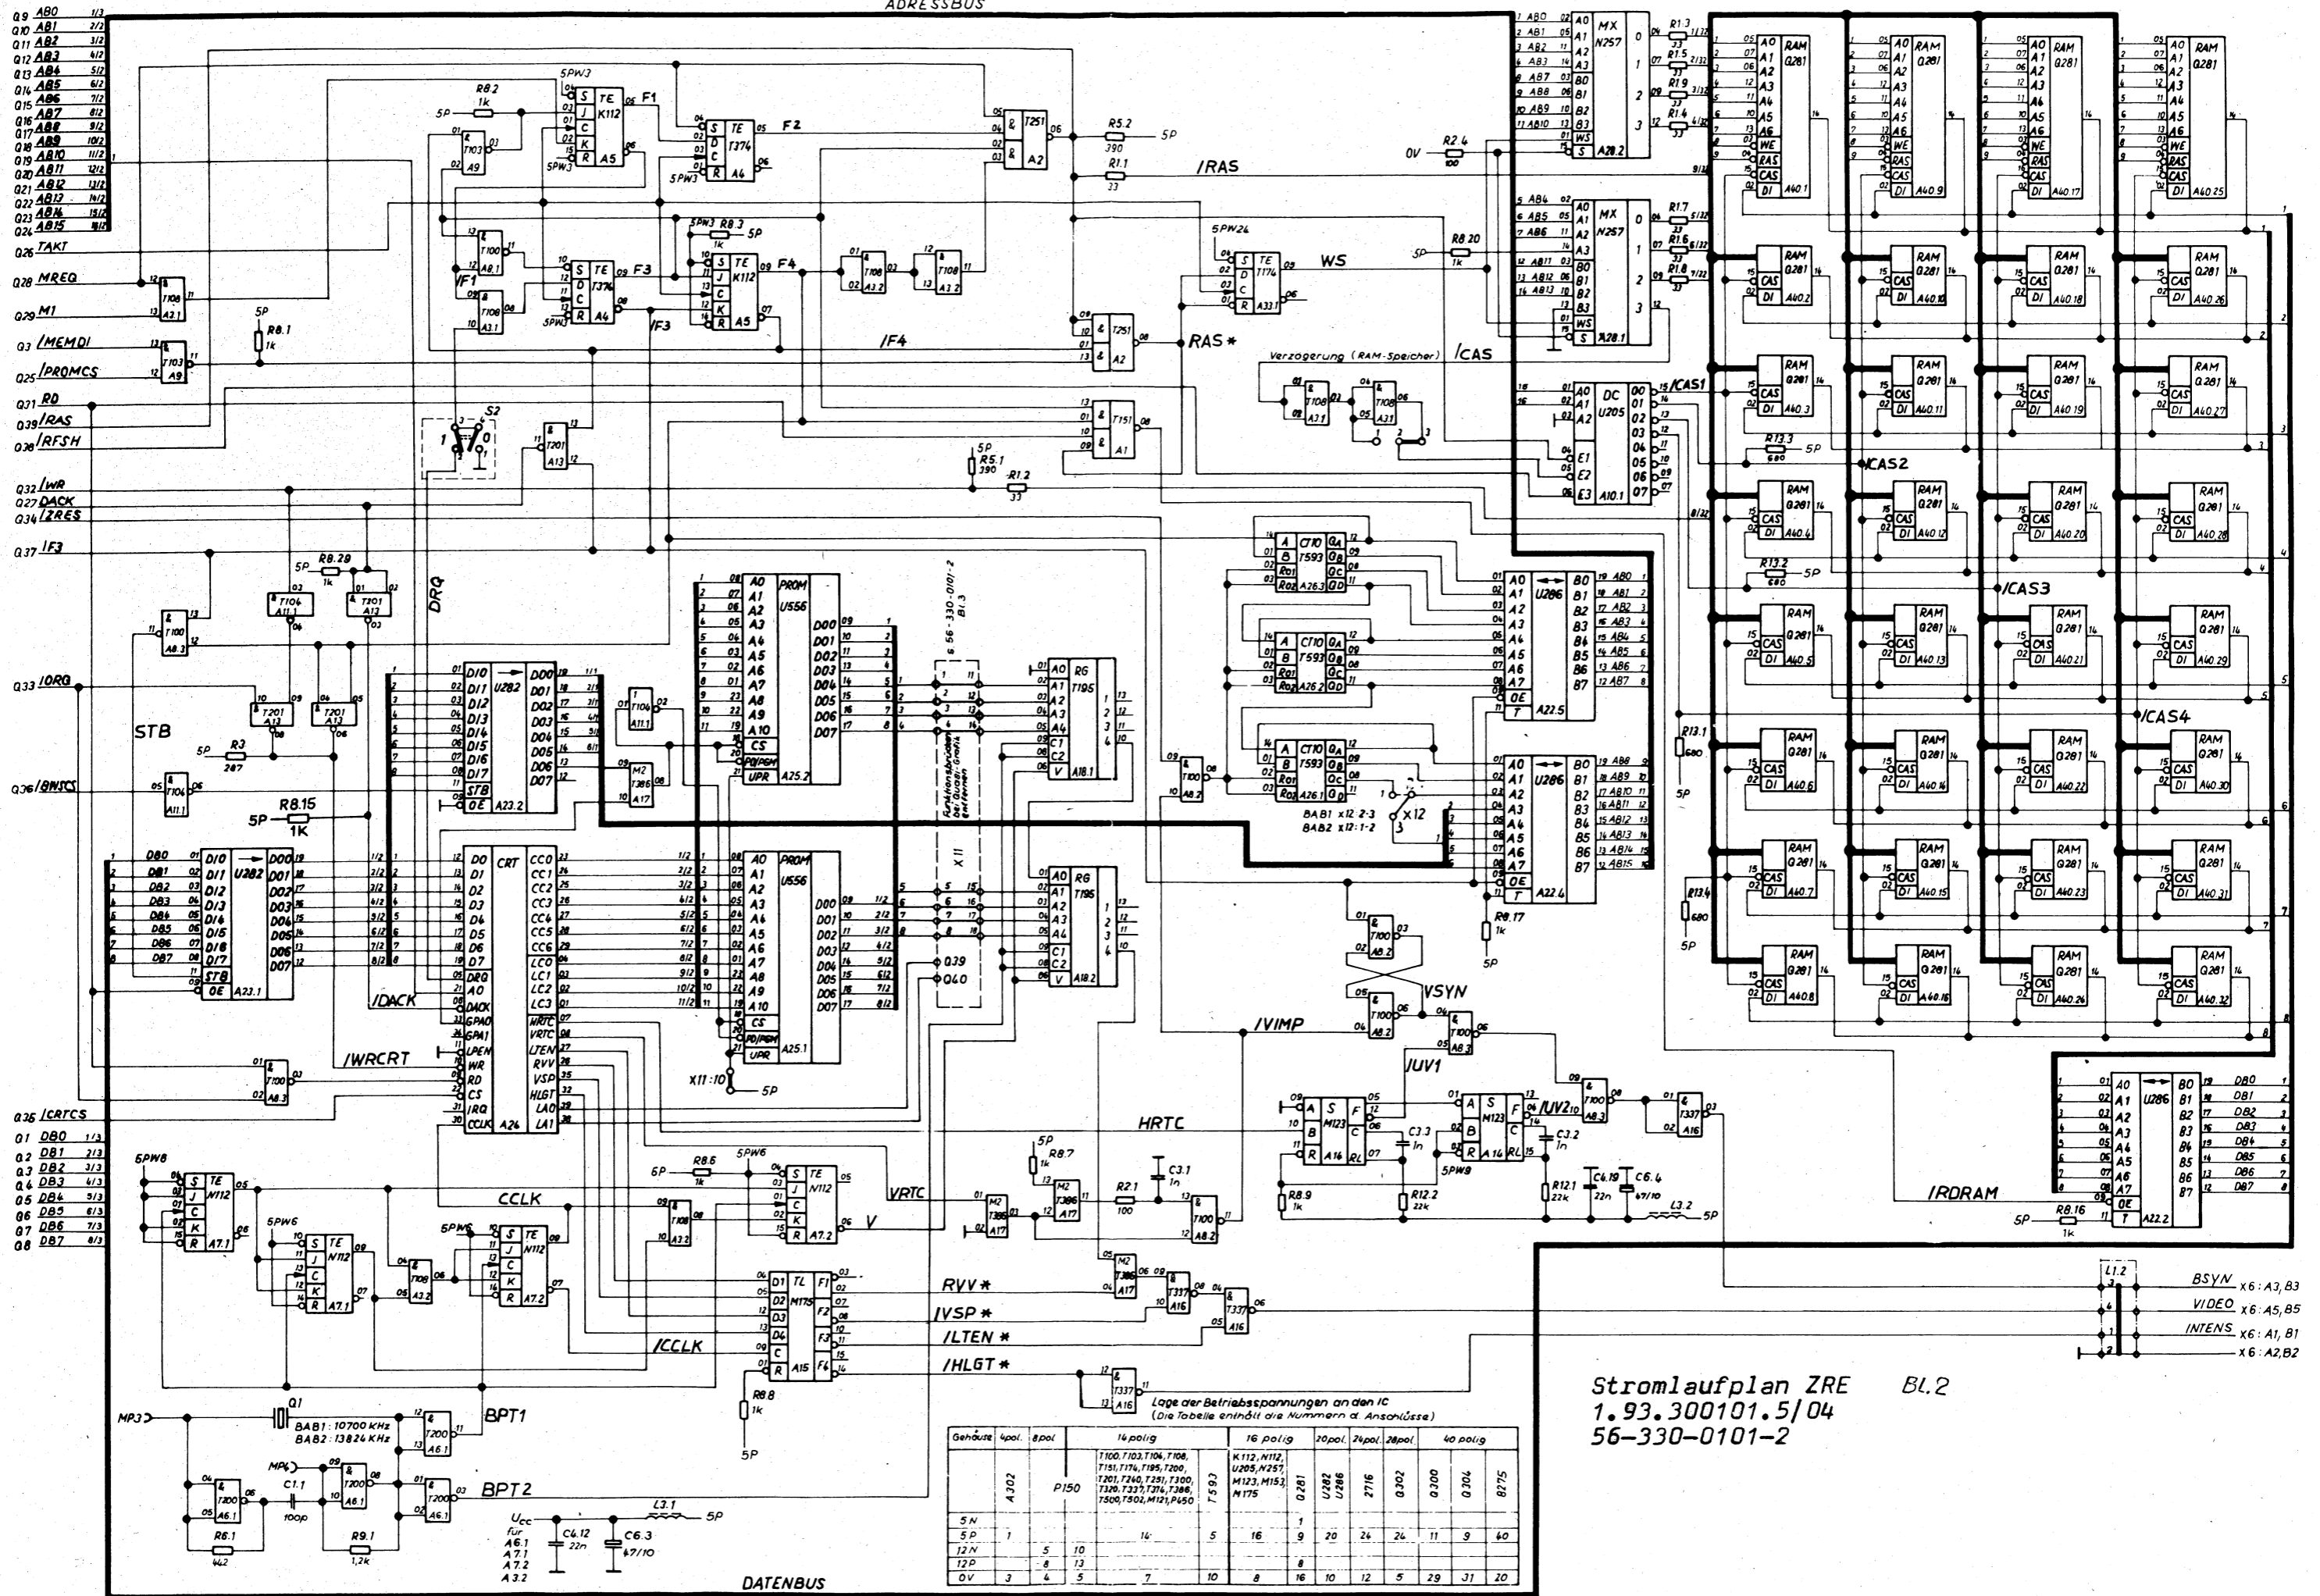

Stromlaufplan ZRE Bl.2
 1.93.300101.5/04
 56-330-0101-2

Lage der Betriebsspannungen an den IC
 (Die Tabelle enthält die Nummern d. Anschlüsse)

Gehäuse	4pol.	8pol.	14 polig	16 polig	20pol.	24pol.	28pol.	40 polig					
A302			1100, 1103, 1104, 1108, 1151, 1174, 1195, 1200, 1201, 1240, 1251, 1300, 1320, 1337, 1374, 1386, 1500, 1502, M121, P150	7593	K112, N112, U205, N257, M123, M153, N175	0281	U282, U286	2716	0302	0300	0304	8275	
5 N	1		14	5	16	1	9	20	24	24	11	9	40
5 P													
12 V		5	10										
12 P													
0 V	3	4	5	7	10	8	16	10	12	5	29	31	20

DATENBUS